


N:\TECHNICAL STANDARDS & CAPITAL SPECS\CITY DETAILS (CAPITAL & PRIVATE)\2020\2020 CURRENT TECH STANDARD MANUAL\DWG\9-04-TYPICAL-STREET-LAMP.DWG, 3/16/2020 9:44:01 AM

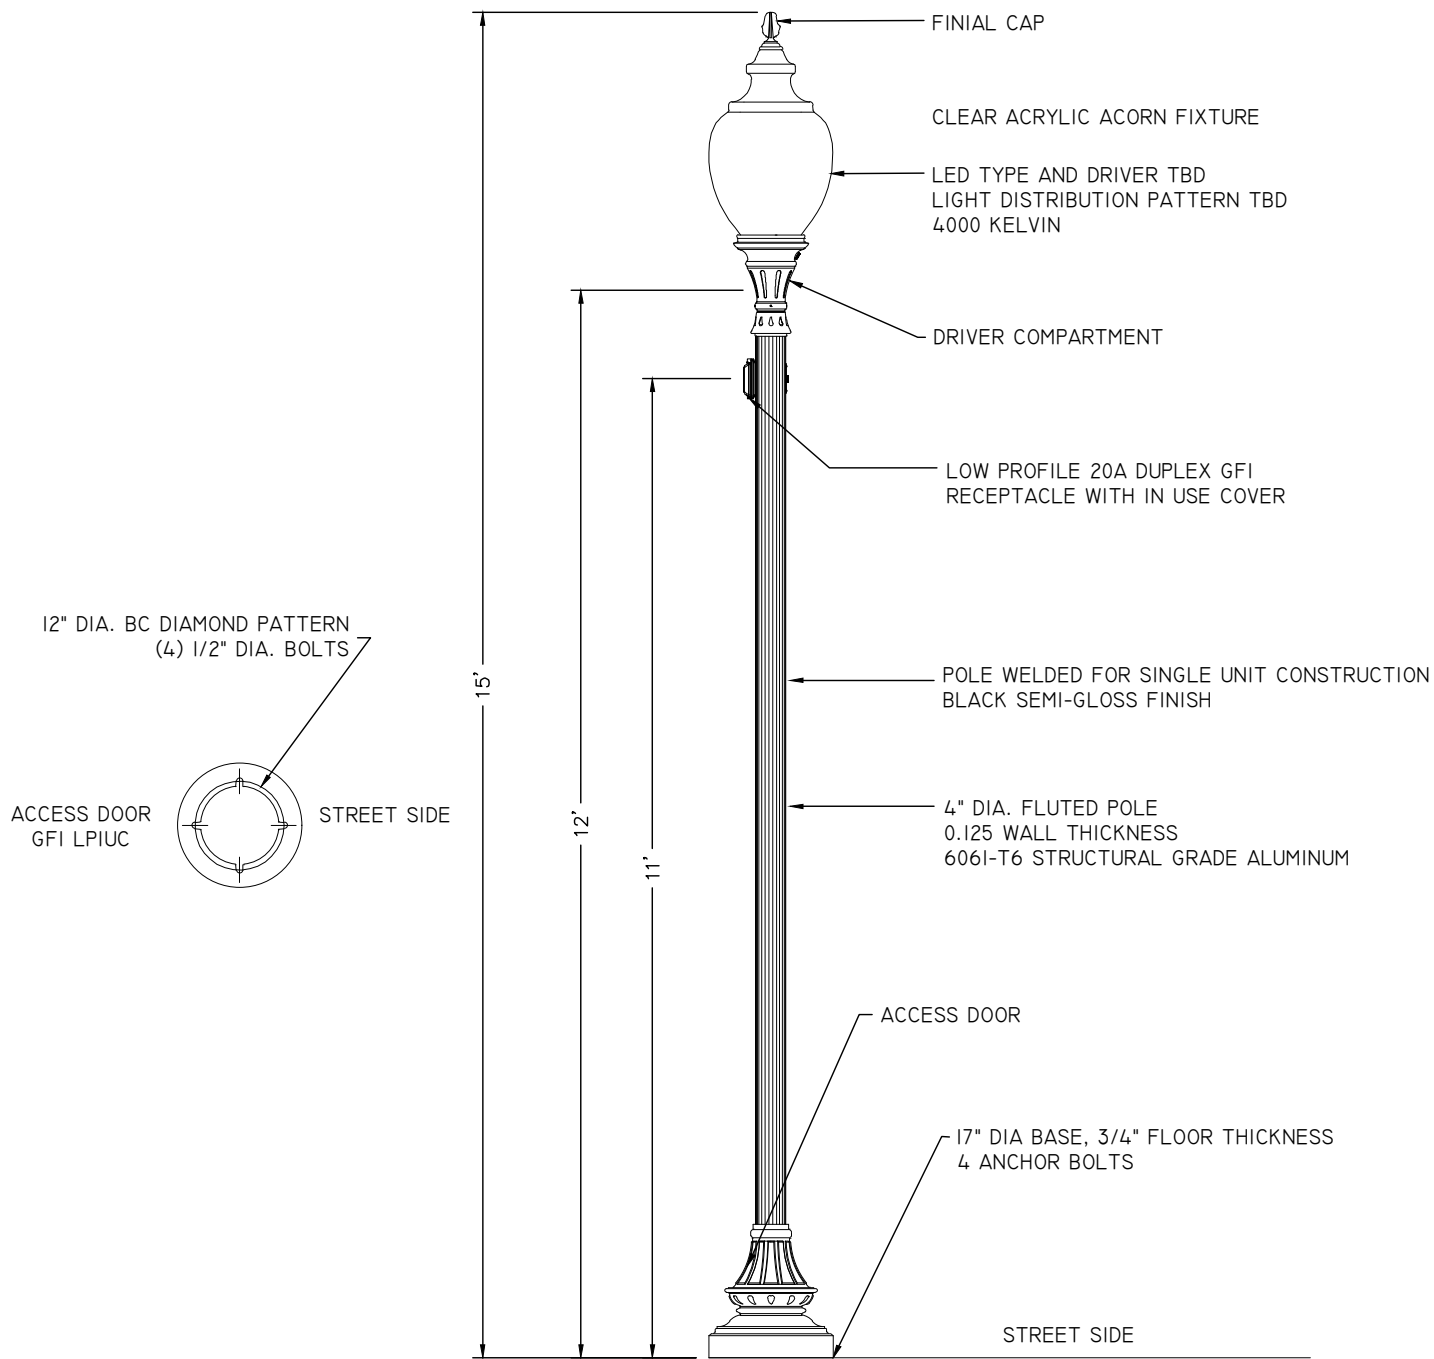

**NOTES:**

MUNICIPALLY MAINTAINED LIGHTING TO CONFORM TO CITY LIGHTING STANDARDS. CONTRACTOR SHALL SUBMIT SHOP DRAWING OF ENTIRE POLE FIXTURE (POLE, SHAFT, FIXTURE, FITTER, DRIVER, LED, TYPE, ETC.) TO THE CITY FOR APPROVAL PRIOR TO FURNISHING.

ELECTRICAL LOAD CAPACITY CALCULATIONS FOR CIRCUITS TO BE PERFORMED BY AN ENGINEER. PRIMARY CONDUCTOR WIRE SIZE AND CONDUIT SIZE TO BE SUBMITTED TO THE CITY FOR APPROVAL PRIOR TO FURNISHING.

FIXTURE AND GFI RECEPTACLE POWERED INDEPENDENTLY AND CONTROLLED BY SEPARATE PHOTOCELLS AT THE PANEL.

<b>STANDARD DETAIL</b>		 <p><b>CITY OF WILMINGTON</b> NORTH CAROLINA</p> <p>CITY OF WILMINGTON ENGINEERING PO BOX 1810 WILMINGTON N.C. 28402 (910) 341-7807</p>
DATE:	MARCH, 2020	
DRAWN BY	JSR	
CHECKED BY	D.E.C., P.E.	
SCALE	NOT TO SCALE	
<b>TYPICAL STREET LIGHT</b>		<b>SD 9-04</b>